


PROFILE

NOTES:

1. SANITARY SEWER MAINS ARE PREFERRED IN CENTER (10') OF THE RIGHT OF WAY.
2. WATER MAINS ARE PREFERRED ON SOUTH AND EAST SIDES OF ROW WITHIN THE LIMITS OF THE PAVED STREET.
3. ALL TRENCHES WITHIN STREET BOUNDARIES (UNDER ASPHALT) SHALL BE COMPACTED TO CITY OF MONTGOMERY ENGR. STANDARD SPECIFICATIONS.
4. MAIN LINE WATER VALVES AT INTERSECTIONS SHALL BE LOCATED WITHIN THE LIMITS OF THE PAVED STREET.
5. DUCTILE IRON SEWER LATERALS WHERE REQUIRED BY DRAWINGS OR DIRECTED BY WATER WORKS INSPECTOR.
6. WATER METERS SHALL BE LOCATED AS INDICATED.
7. FIRE HYDRANTS SHOULD BE RESTRAINED TO VALVES WITH 3/4 " STAINLESS STEEL THRUST TIES OR MEGALUG RESTRAINED JOINTS.
8. SANITARY SEWER LATERALS MUST EXTEND SIX FEET (6') BEYOND LIMITS OF ALL UTILITY EASEMENTS ON BOTH SIDES OF STREET.

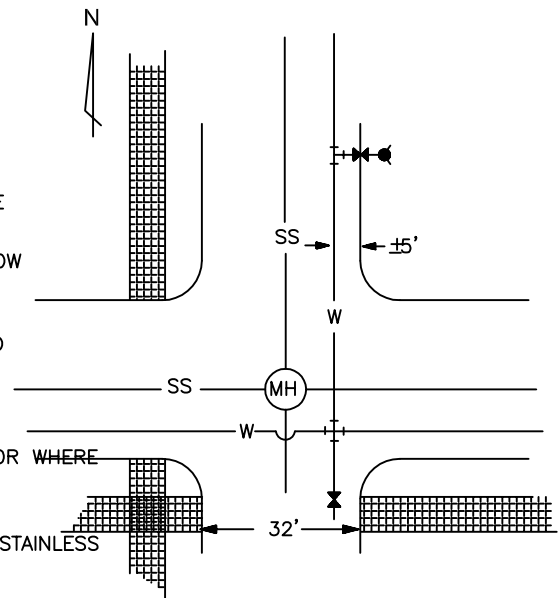

PLAN



WATER
WORKS & SANITARY SEWER BOARD
Montgomery Alabama

MISCELLANEOUS DETAILS

TITLE:

TYPICAL STREET LAYOUT

DRAWING NO.:

130

DESIGNED: TL
CHECKED: HR

DATE: 09/06
REVISED: 02/06

SCALE:
NOT TO SCALE