


PLAN

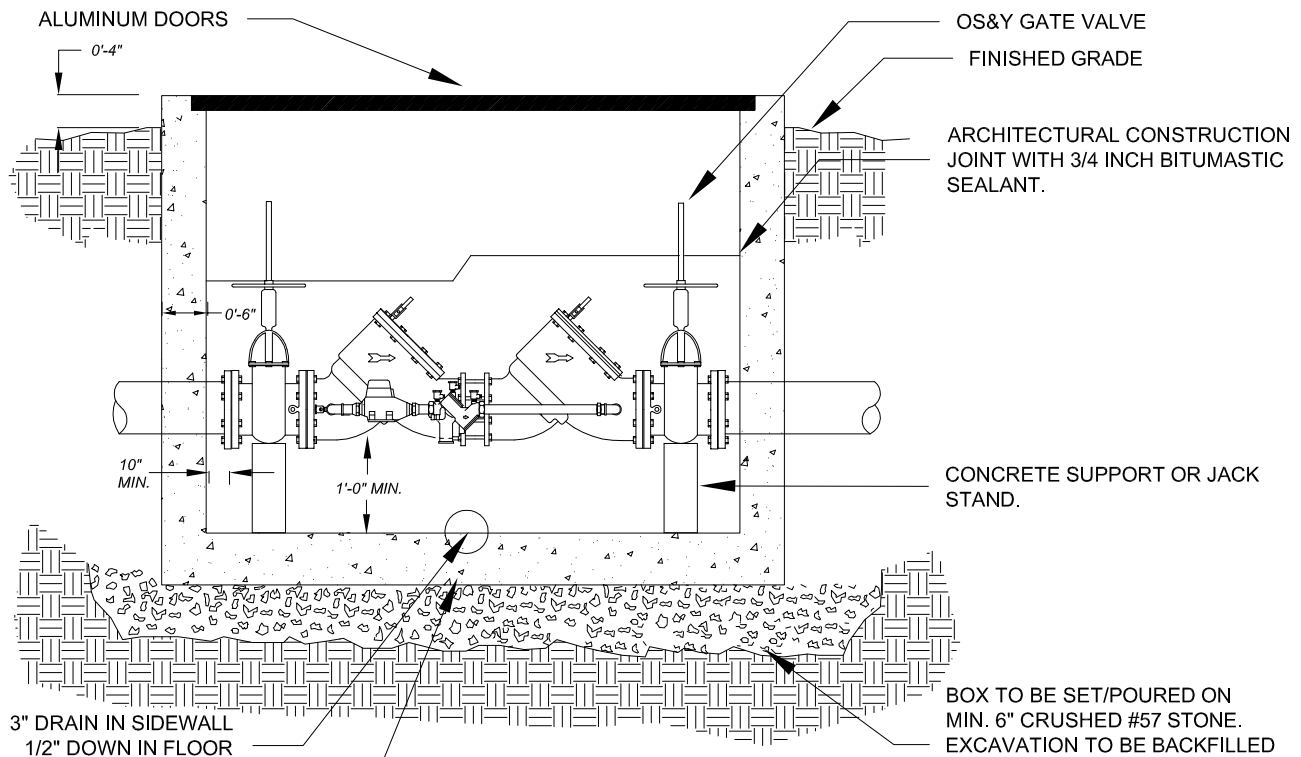

PROFILE

NOTES

LARGE DOUBLE CHECK DETECTOR CHECK BACKFLOW ASSEMBLY (4" AND GREATER): AMES 3000SS, WATTS 709 DCA, OR FEBCO 856.

FLANGED FITTINGS INSIDE PIT, MECHANICAL JOINT W/MEGA-LUG RETAINER GLANDS OUTSIDE OF PIT.

IN LIEU OF POURED-IN-PLACE VAULT, AN APPROVED PRE-CAST VAULT MAY BE USED.

USE BILCO OR U.S. FOUNDRY VAULT DOORS.

ALL SHALL INCLUDE ENCODED RESISTERS W/ TOUCH READ PAD SENSORS MOUNTED IN ALUMINUM DOORS. SENSORS SHALL BE MOUNTED IN THE DOOR OPPOSITE OF THE DOOR THAT OPENS FIRST.

BACKFLOW PREVENTION DEVICES SHALL BE TESTED UPON INSTALLATION.

WATER DISTRIBUTION DETAILS

TITLE: **LARGE DOUBLE CHECK BACKFLOW VAULT**

DRAWING NO.:

225

DESIGNED: TL	DATE: 09/00	SCALE: NOT TO SCALE
CHECKED: BH	REVISED:	



WATER WORKS & SANITARY SEWER BOARD
Montgomery Alabama