



PLAN

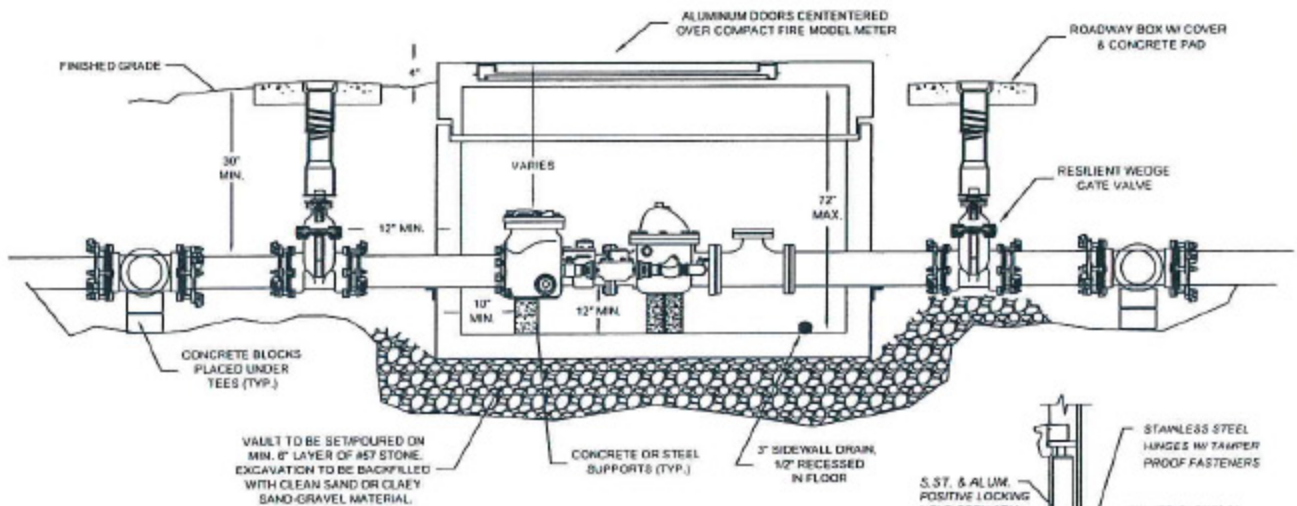

PROFILE

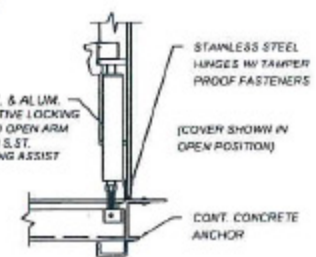

LID DETAIL

NOTES

FIRE MODEL METER ASSEMBLY TO BE USED:
SENSUS COMPACT FIRELINE FIRE SERVICE
ASSEMBLIES

FLANGED FITTINGS INSIDE PIT.

MECHANICAL JOINT FITTINGS W/ "MEGA-LUG"
RETAINER GLANDS OUTSIDE OF PIT.

USE BILCO OR U.S. FOUNDRY VAULT DOOR.

ALL CONCRETE SHALL BE 4000 PSI MIX.

IN LIEU OF POURED-IN-PLACE VAULT. AN
APPROVED PRE-CAST VAULT MAY BE USED.

ALL SHALL INCLUDE ENCODED REGISTERS W/
TOUCH READ PAD SENSORS MOUNTED IN
ALUMINUM LIDS.

SENSORS SHALL BE MOUNTED IN DOOR
OPPOSITE OF THE DOOR THAT OPENS FIRST.



WATER
WORKS & SANITARY SEWER BOARD
Montgomery Alabama

WATER DISTRIBUTION DETAILS

TITLE: FIRE MODEL METER SET-UP				DRAWING NO.:
DESIGNED:	TL	DATE:	07/08	SCALE: NOT TO SCALE
CHECKED:	HR	REVISED:		

230