


PLAN VIEW

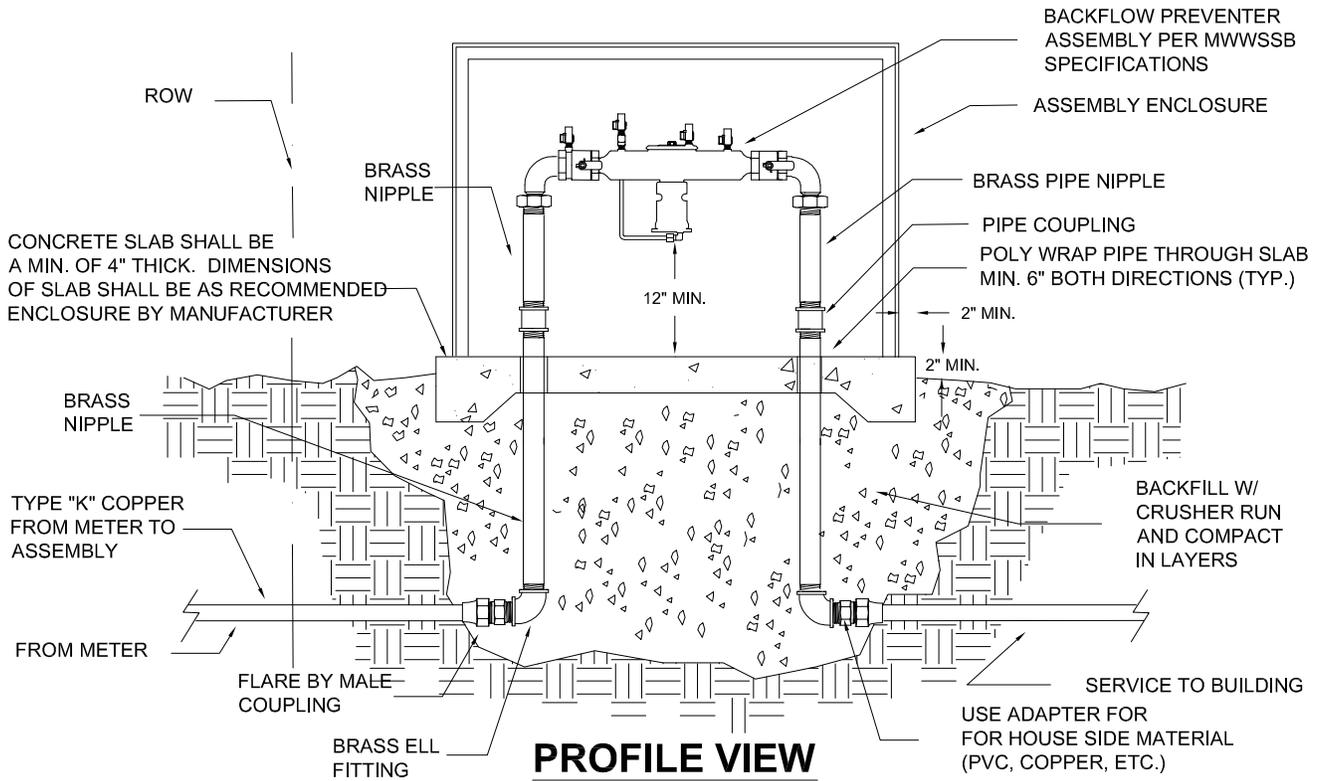

PROFILE VIEW

NOTES

1. REDUCED PRESSURE PRINCIPLE BACKFLOW ASSEMBLIES (RPBAs) SHALL BE AS REQUIRED BY THE BOARD'S CROSS-CONNECTION AND BACKFLOW PREVENTION POLICY (LATEST REVISION). ASSEMBLIES APPROVED FOR INSTALLATION INCLUDE: AMES 400SS, FEBCO MASTER SERIES 860, WATTS SERIES 009, AND WATTS SERIES 909.
2. RPBAs SHALL NOT BE BURIED OR INSTALLED IN BELOW GROUND VAULTS. THE DEVICE SHALL BE INSTALLED ABOVE GROUND AND LOCATED TO PREVENT THE RELIEF OR VENT OPENING FROM BEING SUBMERGED AT ANY TIME.
3. ASSEMBLY ENCLOSURES SHALL BE CONCRETE, REINFORCED ALUMINUM, OR FIBERGLASS CONSTRUCTION, PROVIDING ACCESS THROUGH DOORS AND/OR HINGED LID FOR TESTING AND MAINTENANCE PURPOSES. THE ENCLOSURES SHALL BE "LOCKABLE" TO PROTECT AGAINST VANDALISM. THE ENCLOSURES SHALL HAVE DRAIN OPENINGS SIZED TO ACCOMMODATE THE MAXIMUM DISCHARGE UNDER THE MOST SEVERE CONDITIONS. DISCHARGE POINTS SHALL BE PROTECTED AGAINST INTRUSION OF EITHER WIND, DEBRIS, OR ANIMALS.
4. THE ENCLOSURE SYSTEM SHALL BE CONSTRUCTED, INSTALLED, OR HEATED SUCH AS TO ENSURE AGAINST FREEZING. ENCLOSURES APPROVED FOR INSTALLATION INCLUDE: HYDROCOWL, HOT BOX, AND LOK BOX.
5. BACKFLOW PREVENTION DEVICES SHALL BE TESTED IMMEDIATELY AFTER INSTALLATION.



WATER WORKS & SANITARY SEWER BOARD
 Montgomery Alabama

WATER DISTRIBUTION DETAIL

TITLE: **RPBA INSTALLATION DETAIL**
 (3/4" - 2")

DRAWING NO.:

235

DESIGNED: TL	DATE: 09/00	SCALE: NOT TO SCALE
CHECKED: BH	REVISED:	