


**SECTION A**

\* IF TWO GREASE INTERCEPTORS ARE REQUIRED TO BE IN SERIES, THEN THE FIRST INTERCEPTOR OUT OF THE BUILDING SHALL NOT HAVE BAFFLE SYSTEM. (SEE SCHEMATIC)



**SCHEMATIC**

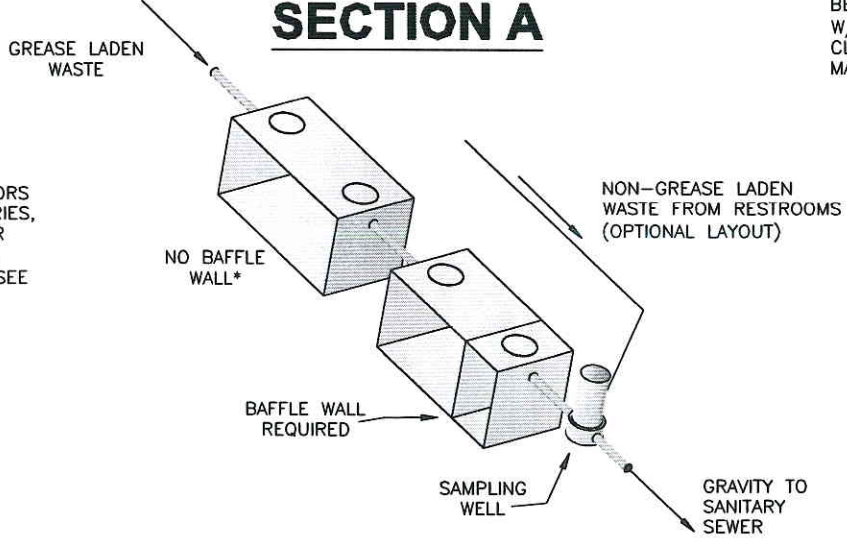

**W**ATER  
WORKS & SANITARY SEWER BOARD  
Montgomery Alabama

**SANITARY SEWER DETAILS**

TITLE:	PRECAST CONCRETE GREASE INTERCEPTOR		
DESIGNED:	CAB	DATE:	01/06
CHECKED:	TL	REVISED:	08/09
SCALE:	NOT TO SCALE		

DRAWING NO.:  
**370**